

Product information

Periphery module

PM MIO84



(valid from 10/2016), for all PC/CCxxx-03 with OS 2.3.9 (-V/-P) or 2.4.1 (-T) and from ConfigStage 1.0.14.28)

Changes to older versions of this document

- Rev. 1 → 2: red error flag of a Out deleted, resolution of a In now 12...16 Bit
- Rev. 2 → 3: address range in process image corrected
- Rev. 3 → 4: LED-references corrected in images
- Rev. 4 → 5: Counter description (like PC351)

Description

compact periphery module for


8 digital transistor outputs 24V with back-readable inputs

- green diagnostic LED for each in-/ output
- insertion stripe with description field for every signal
- cage-clamp connector with self-lock and 2 lift arms
- **Scope of delivery:**
 - technical information
 - brief instruction



INSEVIS-benefit:

Each single outputs can be switched off, so that you can realize different ratios of I/Os e.g. 6dI and 2dO or 3dI and 5dO. Only the total sum of I/Os must be ≤ 8 .


for digital signals (2- and 3-/4-wire-switches)

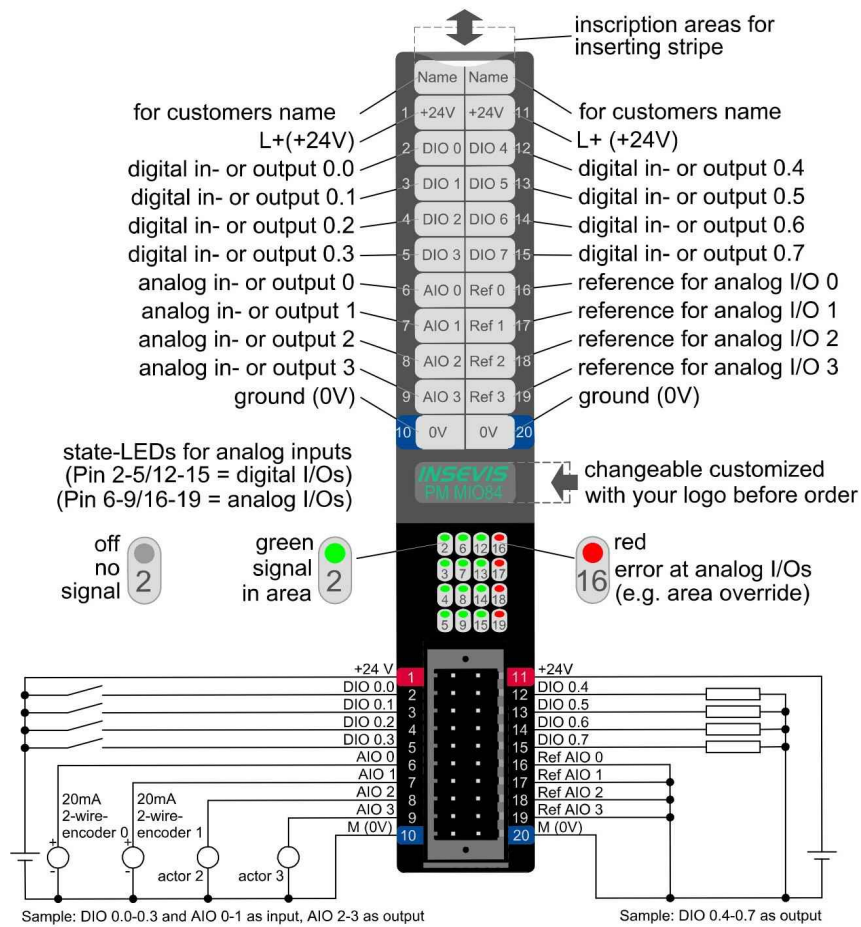

above: Description and wiring of MIO84 for 2-wire switches

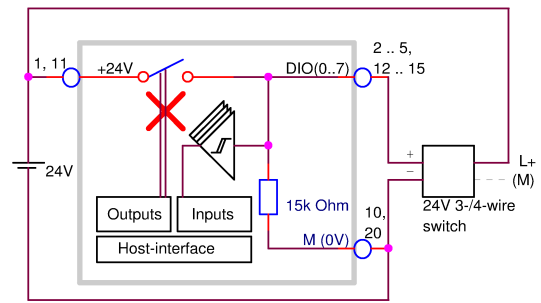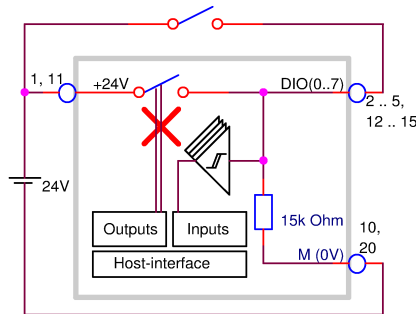

above: Block diagram of digital inputs for 2-wire-switches (left) and 3-/4-wire-switches (right)

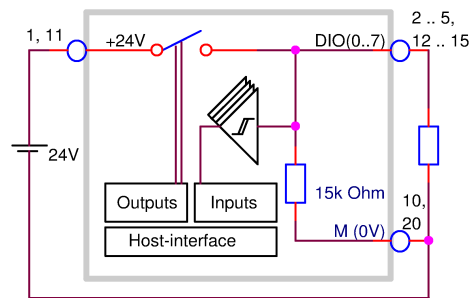

above: Block diagram of backreadable outputs

Digital	Input address	Output address
	Disable the output	
Channel 0.0	16.0	<input checked="" type="checkbox"/>
Channel 0.1	16.1	<input checked="" type="checkbox"/>
Channel 0.2	16.2	<input type="checkbox"/>
Channel 0.3	16.3	<input type="checkbox"/>
Channel 0.4	16.4	<input checked="" type="checkbox"/>
Channel 0.5	16.5	<input type="checkbox"/>
Channel 0.6	16.6	<input type="checkbox"/>
Channel 0.7	16.7	<input type="checkbox"/>

above: Configuration block of I/O-parametrizing in the ConfigStage

Description

- 4 analog in- or outputs configurable by software

Inputs:
 - 0..10V, 0 (4)..20 mA for 2-wire-encoders including encoder supply
 - 4..20 mA or ± 20 mA for 4-wire-encoders
 Outputs:
 - 0..10V
 - 0 (4)..20 mA

• Resolution 12 ... 16 Bit (depending on integration time)

• green diagnostic-LEDs
 - LED 6 for A I/O 0
 - LED 7 for A I/O 1
 - LED 8 for A I/O 2
 - LED 9 for A I/O 3

• red diagnostic-LEDs for errors (override or short circuit on AI)
 - LED 16 for A I/O 0
 - LED 17 for A I/O 1
 - LED 18 for A I/O 2
 - LED 19 for A I/O 3


• insertion stripe with description field for every signal
 • cage-clamp connector with self-lock and 2 lift arms

• **Scope of delivery:**
 - technical information
 - brief instruction


Hint:
 Connect Ref AIO 0..3 with ground (0V) always

INSEVIS-benefit:
 This module has an internal supply for the 2-wire encoders. So it is not necessary to care for external supply!

for analog inputs (2-wire-encoders)

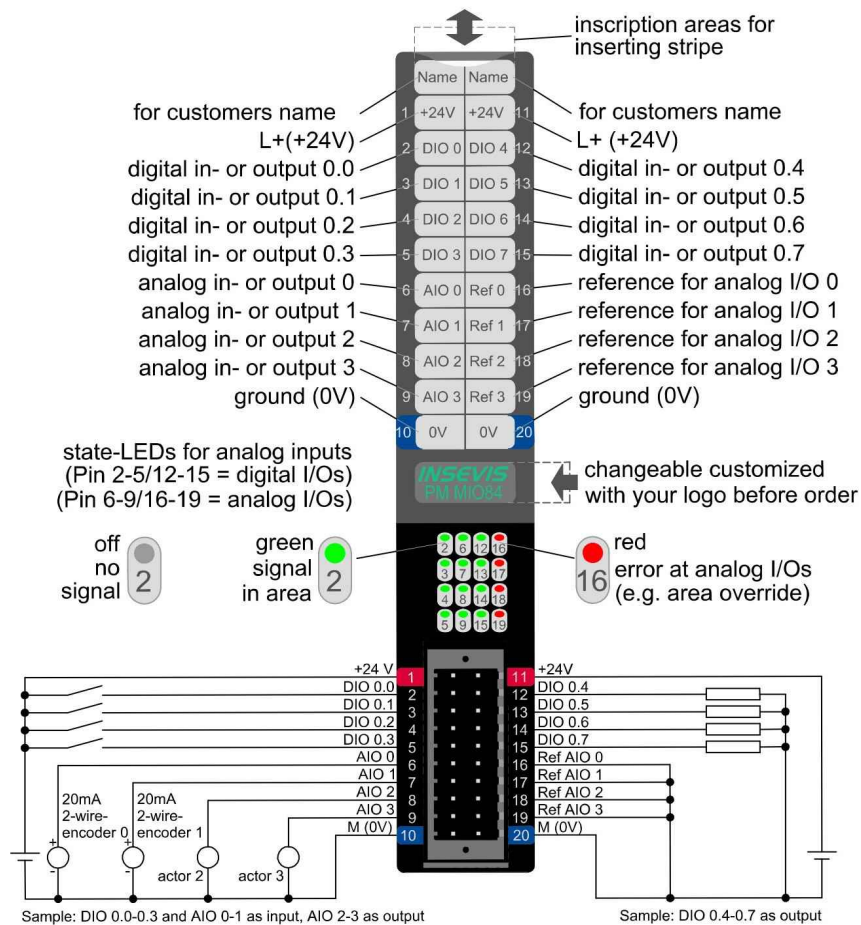

above: Description and wiring of all connections of PM MIO84 with 2-wire encoders

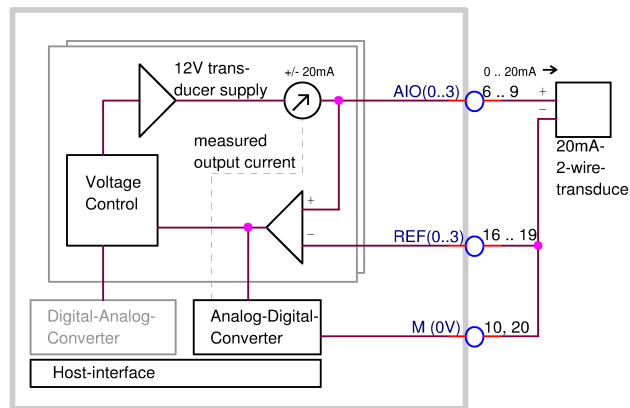

above: Block diagram for 2-wire-encoders (0..20mA)

Analog			
Integration time [ms]:			4
	Type	Mode	Address
Channel 1:	Input	0..10V	8
Channel 2:	Input	4..20mA (2-wire)	10
Channel 3:	Output	0..10V	12
Channel 4:	Output	4..20mA	14

above: Configuration block of I/O-parametrizing in the ConfigStage

Description

for analog inputs (3-/4-wire-encoders)

- 4 analog in- or outputs configurable by software

Inputs:
 - 0..10V, 0 (4)..20 mA for 2-wire-encoders including encoder supply
 - 4..20 mA or ± 20 mA for 4-wire-encoders

Outputs:

- 0..10V
 - 0 (4)..20 mA

- Resolution 12 ... 16 Bit (depending on integration time)

- green diagnostic-LEDs
 - LED 6 for A I/O 0
 - LED 7 for A I/O 1
 - LED 8 for A I/O 2
 - LED 9 for A I/O 3

- red diagnostic-LEDs for errors (override or short circuit on AI)
 - LED 16 for A I/O 0
 - LED 17 for A I/O 1
 - LED 18 for A I/O 2
 - LED 19 for A I/O 3

- insertion stripe with description field for every signal


- cage-clamp connector with self-lock and 2 lift arms

• Scope of delivery:


- technical information
- brief instruction

Hint:


Connect Ref AIO 0..3 with ground (0V) always

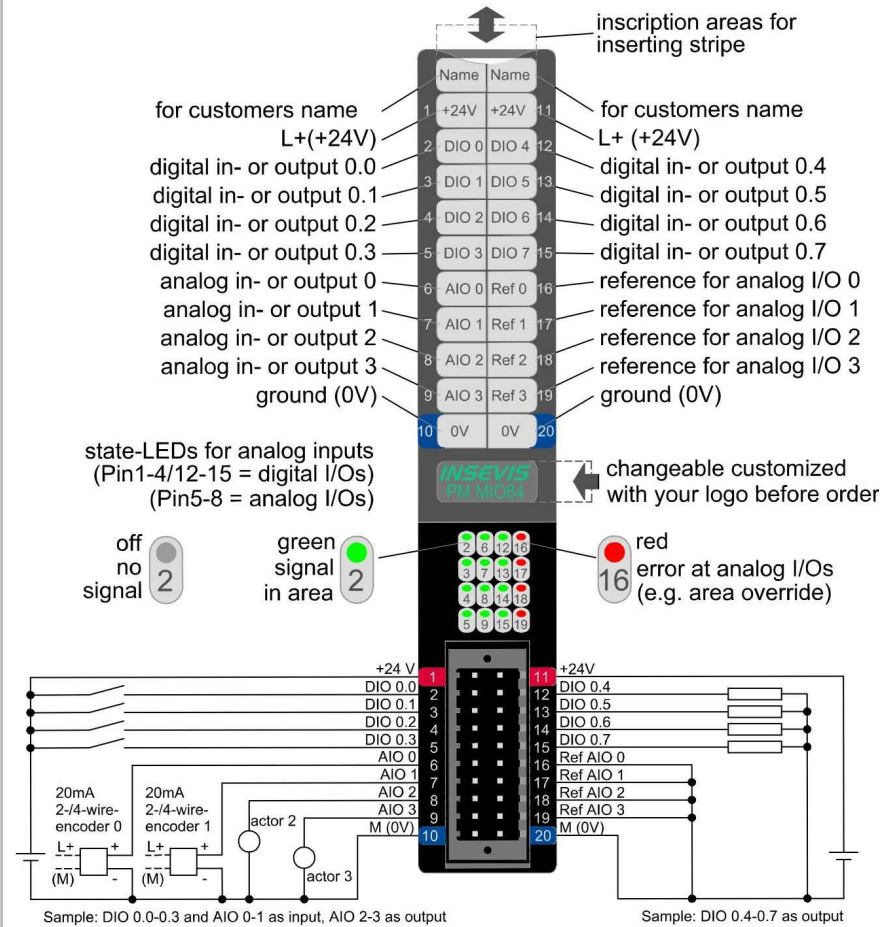

above: Description and wiring of all connections of PM MIO84 with 3-/4-wire encoders

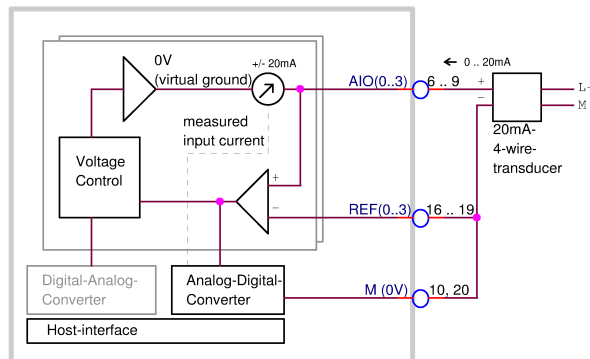

left: Block diagram for 3-/4-wire-encoders (0..20mA)

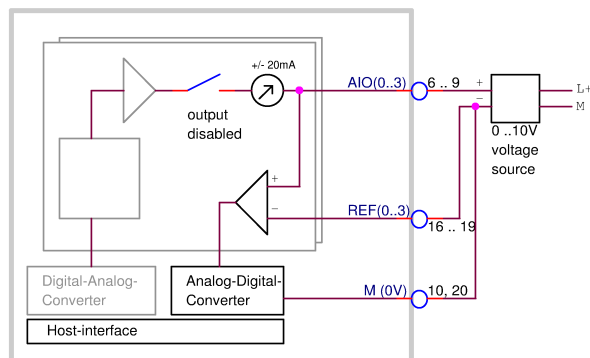

left: Block diagram for 3-/4-wire-encoders (0..10V)

Description

- 4 analog in- or outputs configurable by software

Inputs:
 - 0..10V, 0 (4)..20 mA for 2-wire-encoders including encoder supply
 - 4..20 mA or ± 20 mA for 4-wire-encoders

Outputs:

- 0..10V
 - 0 (4)..20 mA

- Resolution 12 ... 16 Bit (depending on integration time)

- green diagnostic-LEDs
 - LED 6 for A I/O 0
 - LED 7 for A I/O 1
 - LED 8 for A I/O 2
 - LED 9 for A I/O 3

- red diagnostic-LEDs for errors (override or short circuit on AI)
 - LED 16 for A I/O 0
 - LED 17 for A I/O 1
 - LED 18 for A I/O 2
 - LED 19 for A I/O 3

- insertion stripe with description field for every signal

- cage-clamp connector with self-lock and 2 lift arms


• Scope of delivery:

- technical information
- brief instruction


Hint:

Connect Ref AIO 0..3 with ground (0V) always


for analog outputs

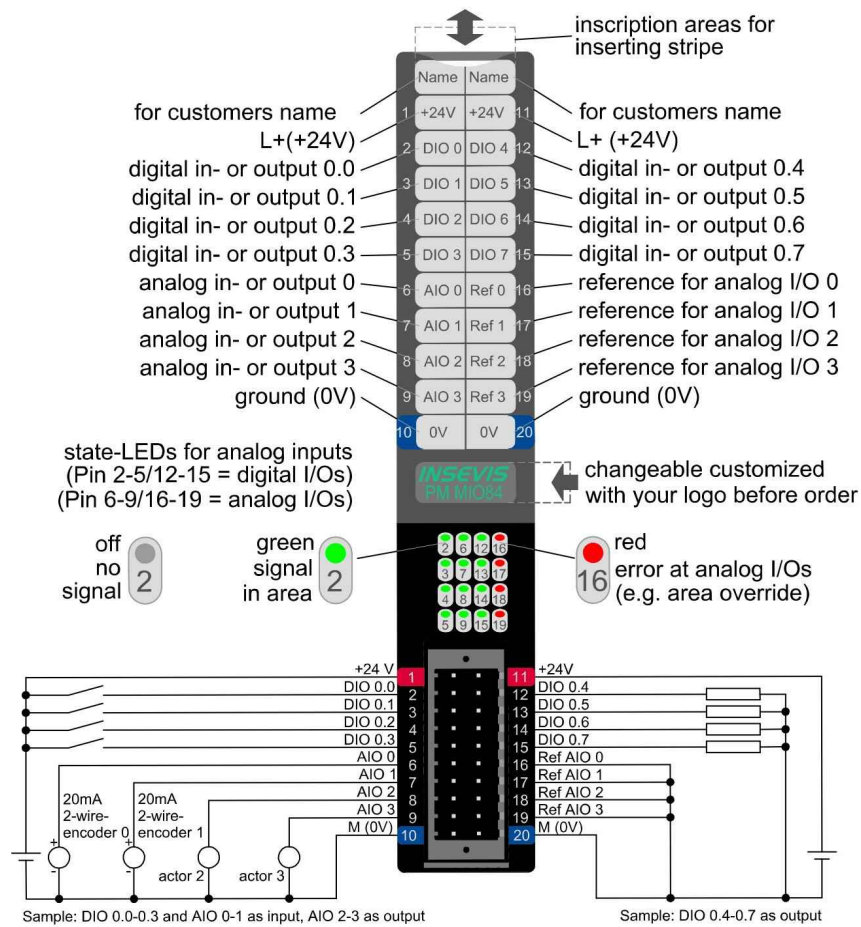

above: Description and wiring of all connections of PM MIO84 for analog outputs

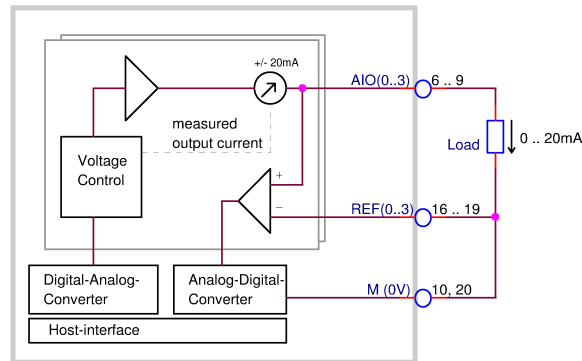

left: Block diagram for analog outputs (0...20mA)

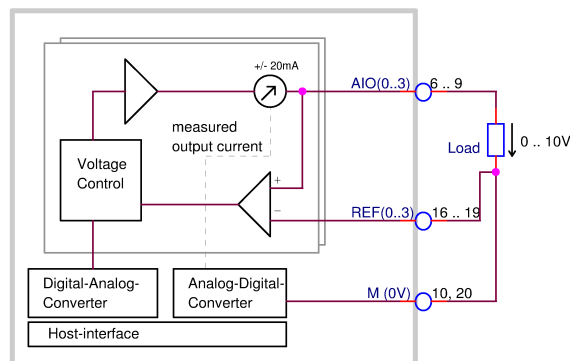

left: Block diagram for analog outputs (0...10V)

Configuration of the counter inputs

Counter 1 (settings by ConfigStage)

Configuration „counting forward (up)“

→ rising edges will be counted at DI 0.0

Configuration „counting for- / backwards (down)“

→ rising edges will be counted at DI 0.0 and
→ DI 0.1 is used as direction bit (0=backwards, 1=forward)

Configuration „Encoder“

→ DI 0.0/ 0.1 with quadruple evaluation

Counter		
	Configuration	Address
Channel 1:	Count up	16
Channel 2:	Count up	20
	Up/Down (Pulse/Dir)	
	Encoder (x4)	

Counter 2 (settings by ConfigStage)

Configuration „counting forward (up)“

→ rising edges will be counted at DI 0.2

Configuration „counting for- / backwards (down)“

→ rising edges will be counted at DI 0.2 and
→ DI 0.3 is used as direction bit (0=backwards, 1=forward)

Configuration „Encoder“

→ DI 0.2/ 0.3 with quadruple evaluation

Counter		
	Configuration	Address
Channel 1:	Count up	16
Channel 2:	Disabled	20
	Up/Down (Pulse/Dir)	
	Encoder (x4)	

Hints for usage of the counter inputs

- all addresses are specified as offset relating to the configured start address

onboard:

- read in counter by reading of ED16 / ED20 (synchronous to control point)
- set counter by writing to PAD16 / PAD20 (by direct periphery access only)
- this configuration can be modified in runtime with Step7 too:

Configuration word for counter 1 is PAW24

Configuration word for counter 2 is PAW28

“inactive”	0x00
“counting forward / up”	0x01
“for- / backward (pulse, direction)”	0x02
“encoder (x4)”	0x03

decentral:

- read in counter by reading of ED12 / ED16 (synchronous to control point)
- Direct periphery access is implemented for decentral periphery only for data which are mapped into the process image. To set counters or write configuration use CANopen objects via SDO access.

Configuration word for counter 1	object index 0x3010 + slot-1, subindex 6
Configuration word for counter 2	object index 0x3010 + slot-1, subindex 7
setpoint counter 1 (dw)	object index 0x3100 + slot-1, subindex 1
setpoint counter 2 (dw)	object index 0x3100 + slot-1, subindex 2

Technical data		digital in-/ outputs	
Load voltage L+ Power dissipation	24V DC (10 V ... 30 V DC) internal limited	Wire length unshielded (max.) shielded (max.)	30 m 100 m
Digital in- / outputs	8 in- or outputs	Outputs: switch on delay switch off delay	50 μ s (typ.) 30 μ s (typ., without load)
Diagnostic LEDs	8, green	Inputs: switch on delay switch off delay	25 μ s
Output current for signal 0 for signal 1	0,5 mA (max.) 0,5 A (max. to 60°C)	Max. switching frequency of outputs	100 Hz with ohmic load
Cumulated current	2 A (max. to 60°C)	Counter	2 each as forward counter, forward/backward counter or incremental encoder
Broken wire detection Error diagnostic Potential separation to PLC	no no	Frequency limit	10 kHz
		Signal level of outputs for signal 0 for signal 1 Signal level of inputs for signal 0 for signal 1	1,0 V at 500 Ω (max.) L+ - 1,0 V at 0,5 A load (min.) 0V ... +5 V +7,5V ... +30 V

Technical data		analog in-/ outputs	
Load voltage L+	24V DC (17 V ... 30 V DC) connected by device supply	Wire length unshielded (max.) shielded (max.)	30 m 100 m
Analog inputs	4 (alternatively to outputs what is to be configured by software)	Valid voltage between inputs and A-GND (max.)	-1 V ... +24 V DC
Input areas	\pm 20 mA, 4...20 mA, 0..10 V	Error message during override metering area	adjustable diagnosis- and limit value alert on request
Diagnostic LEDs	4 green: signal in valid area 4 red: override or saturation no displaying broken wires and open inputs	Broken wire detection	by overrun / shortfall of metering area
Value number format	9400 ... 6C00 (hexadecimal) for range \pm 20 mA all other 0000 ... 6C00 (hexadecimal)	Acces of sensor	unsymetric against A-GND (single ended)
Override area	20 mA ... 22 mA 10V ... 11,3 V	Metering priciple / conversion priciple Resolution	successive approximation 12...16Bit (depending on integration time assigned in ConfigStage)
Imput resitance	0 Ω (typ.) for metering area current 1M Ω (typ.) for metering area voltage	Deviation (based on input area)	< 1%
Sampling cycle time = Integration time	adjustable 1ms ... 35767 ms default: 100 ms (=line frequency filter 50Hz and 60Hz)		
Analog outputs	4 (alternatively to inputs what is to be configured by software)	Value number format	0000 ... 6C00 (hexadecimal)
Output area (nominal values)	0(4)...20 mA, 0...10V	Short cut protection	yes
Resolution	15 Bit $\Sigma\Delta$ -Modulation	Override area	20 ... 23 mA 10 ... 11,3 V
Diagnostic LEDs	4 green: signal in valid area 4 rot: override or Load error	Short cut current (typ.)	20 mA (at 10V) 32 mA (at mA)
Setting time: response time τ (typ)	1,5 ms	Deviation (based on output area)	< 1%
Load resistance against A-GND	mA: 500 Ω (max.) V: 1 k Ω (min.)		

Configuration of the **process image onboard**:
module allocates 24 bytes of process data input and output.

Offset	I/O	Function	Description
0, 2, 4, 6	I	Input AI 0..AI 3	Measuring range according to configuration - in voltage output mode: measure of output current - in current output mode: measure of output voltage
0, 2, 4, 6	O	Output AO0..AO 3	Measuring range according to configuration - in input mode: ignored
8	I	Digital inputs .0 to .7	(Byte access)
8	O	Digital outputs .0 to .7	(Byte access)
9 ... 15	I/O	Reserved	
16, 20	I/O	Counter 0, 1	Counter value (DINT, DWORD access)

Configuration of the **process image as decentral periphery**:
module allocates 20 bytes of process data input and 9 bytes of process data output.

Offset	I/O	Function	Description
0, 2, 4, 6	I	Input AI 0..AI 3	Measuring range according to configuration
0, 2, 4, 6	O	Output AO0..AO 3	Measuring range according to configuration
8	I	Digital inputs .0 to .7	(Byte access)
8	O	Digital outputs .0 to .7	(Byte access)
9 ... 11	I	Reserved	
12,16	I	Counter 0, 1	Counter value (DINT, DWORD access)

Ordering data accessoires

Identification	Order-no.	Packaging unit
Connector 2x10pin with pin markings and lift arms on side	E-CON20D-00	PU: 1 piece
Connector 2x10pin with pin markings and bolt flanges on side	E-CONS20D-00	PU: 1 piece
Spare part: Inserting stripe for description fields, 2x11 fields *	E-LABES22-00	PU: 20 pieces
Inserting stripe V for logo and identification for rear side *	E-LABV-00	PU: 100 pieces

* (1x already part of first deliveries scope)

Qualified personnel

All devices described in this manual may only be used, built up and operated together with this documentation. Installation, initiation and operation of these devices might only be done by instructed personnel with certified skills, who can prove their ability to install and initiate electrical and mechanical devices, systems and current circuits in a generally accepted and admitted standard.

Manuals, sample programs

Additional documentation by manuals is available as well sample applications at the download area of www.insevis.com in English language for free download.

Copyright

This and all other documentation and software, supplied or hosted on INSEVIS web sites to download are copyrighted. Any duplicating of these data in any way without express approval by INSEVIS GmbH is not permitted. All property and copy rights of these documentation and software and every copy of it are reserved to INSEVIS GmbH.

Disclaimer

All technical details in this documentation were created by INSEVIS with highest diligence. Anyhow mistakes could not be excluded, so no responsibility is taken by INSEVIS for the complete correctness of this information. This documentation will reviewed regularly and necessary corrections will be done in next version.

With publication of this data all other versions are no longer valid.